


Water treatment II

Today's lecture


- Sedimentation
- Filtration
- Disinfection
- Chlorine disinfection chemistry
- Membrane processes
- Sludge treatment and disposal

Water treatment systems

- Coagulation plant (surface water)

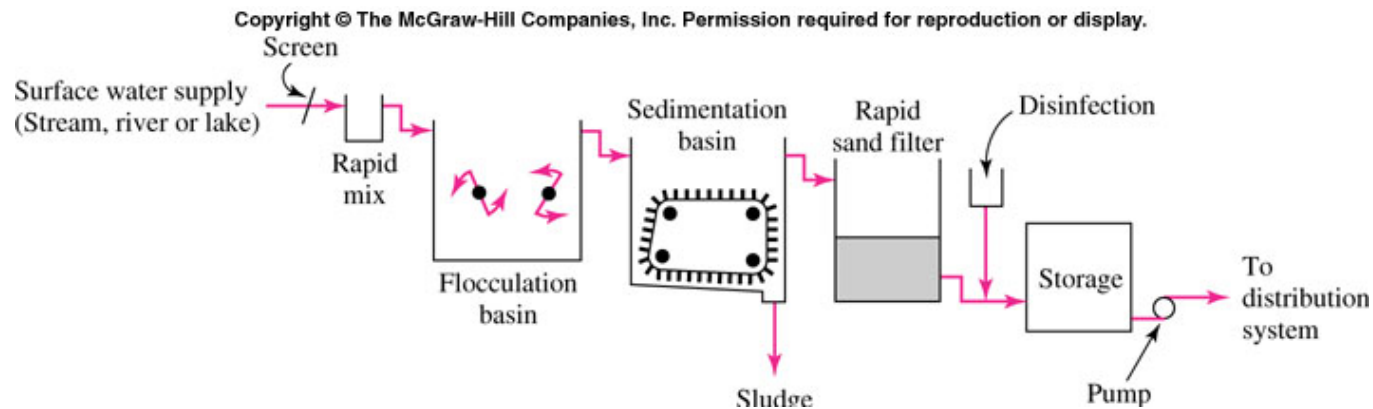


- Water softening plant (groundwater)

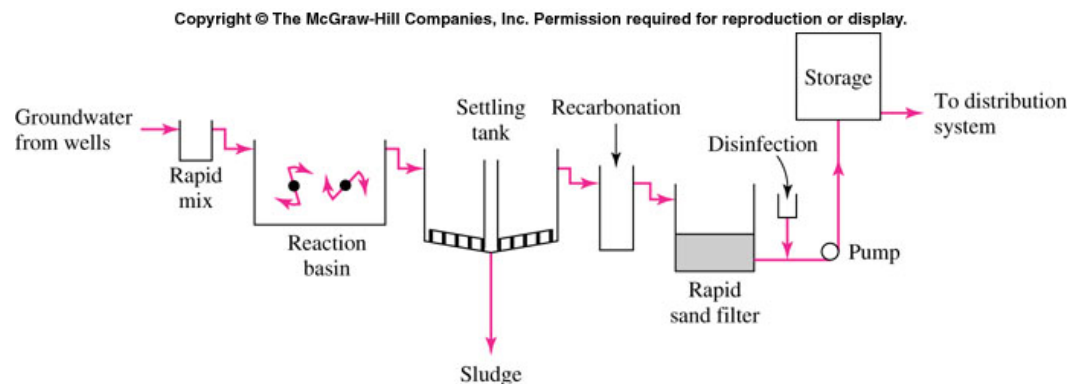

Sedimentation


- Sedimentation basins: (a) rectangular (b) circular

Copyright © The McGraw-Hill Companies, Inc. Permission required for reproduction or display.

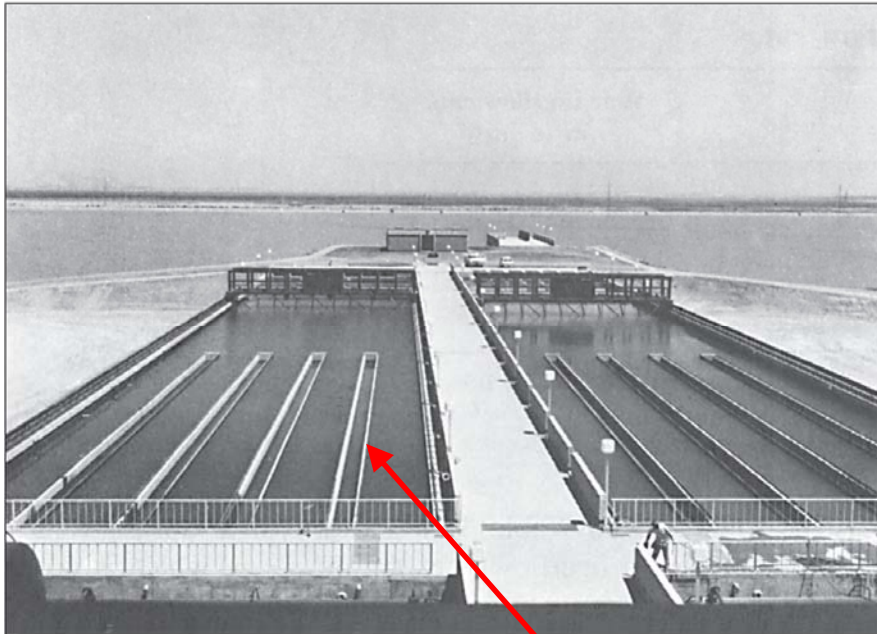

(a)

Copyright © The McGraw-Hill Companies, Inc. Permission required for reproduction or display.

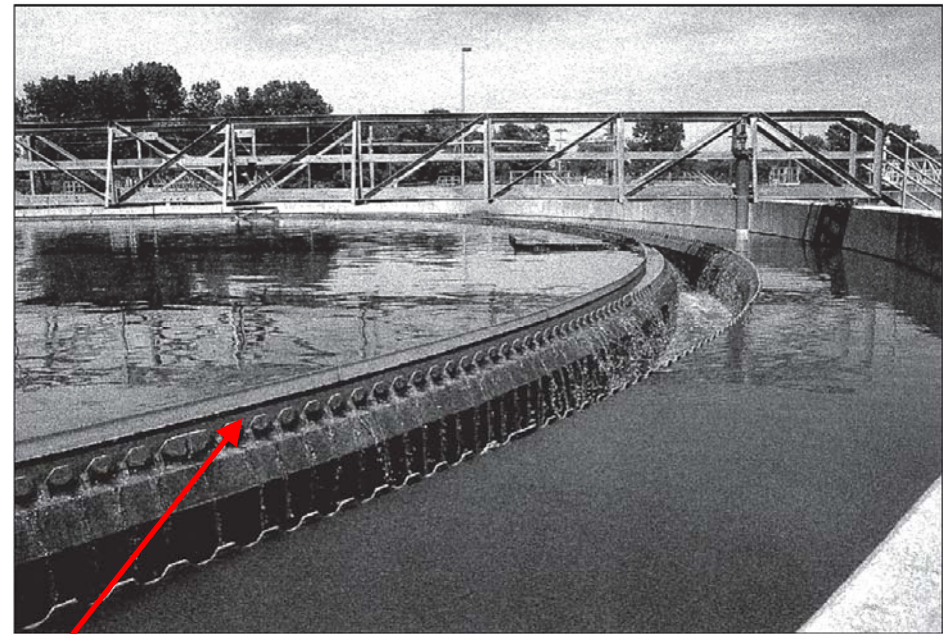

(b)

Weir

Sedimentation

- Design parameters

- Retention (detention) time: 2-4 hr

- Overflow rate, v_o

$$v_o = \frac{Q}{A_c}$$

Q = water flow rate (m³/s)

A_c = surface area of the sedimentation basin (m²)

- Weir loading (WL)

$$WL = \frac{Q}{L_{weir}}$$

L_{weir} = weir length (m)

- * Large, dense particles: better settling properties

- higher v_o and WL allowed


Filtration

- The effluent of the sedimentation basin still contains particles that are too small to settle
- Filtration is the final step of particle removal from water
- Goal: turbidity and pathogen removal
 - Pathogens are small particles (virus: 5-50 nm, bacteria: 0.5-10 μm , protozoa oocysts: 2-20 μm)
- Water flows downward through a bed of granular media, and particles in water are trapped by the media

Filtration

- As particles are removed, filter becomes clogged → “head loss” increases → water becomes harder to pass the filter & effluent turbidity increases
- “Backwash” of filter needed (takes about 10-15 min, about once per day)

- Backwash
 - Water flow upward at a high speed to expand the media
 - Particles are washed out and collected

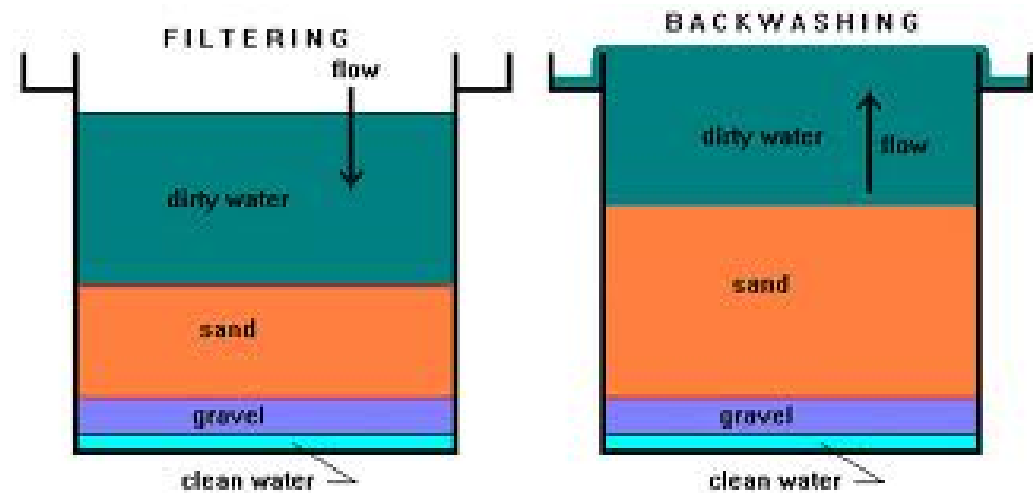

<http://www.rpi.edu>

Filtration

- Filter media
 - Single media: sand only
 - Dual media: anthracite coal and sand (most common)
 - Multimedia: anthracite coal, sand, and garnet
- Large, lighter particles on the top and small, heavier particles on the bottom → can use full depth of the filter bed & maintain the layers after backwashing

| Material | Grain density (g/cm ³) | Effective size (mm) |
|-----------------|------------------------------------|---------------------|
| Anthracite coal | 1.6-1.7 | 1.5-2.5 |
| Sand | 2.4-2.6 | 0.6-0.95 |
| Garnet | 4.5 | 0.4-0.5 |

Disinfection

- Goal: to inactivate (kill) pathogens
- Disinfection kinetics

– Chick's law:

$$\frac{dN}{dt} = -kN \longrightarrow \ln\left(\frac{N}{N_0}\right) = -kt$$

N = number of organisms
 k = first-order reaction constant

– Chick-Watson law: consider the concentration of the disinfectant as a variable

$$\ln\left(\frac{N}{N_0}\right) = -k'C^n t$$

$k = k'C^n$
 C = disinfectant concentration, mg/L
 n = coefficient


→ The efficiency of disinfection depends on disinfectant concentration (C) and contact time (t)

Disinfection

- Goal: to inactivate (kill) pathogens by 99-99.9% (2-3 log removal)
- What is the appropriate reactor design?



Chlorine disinfection

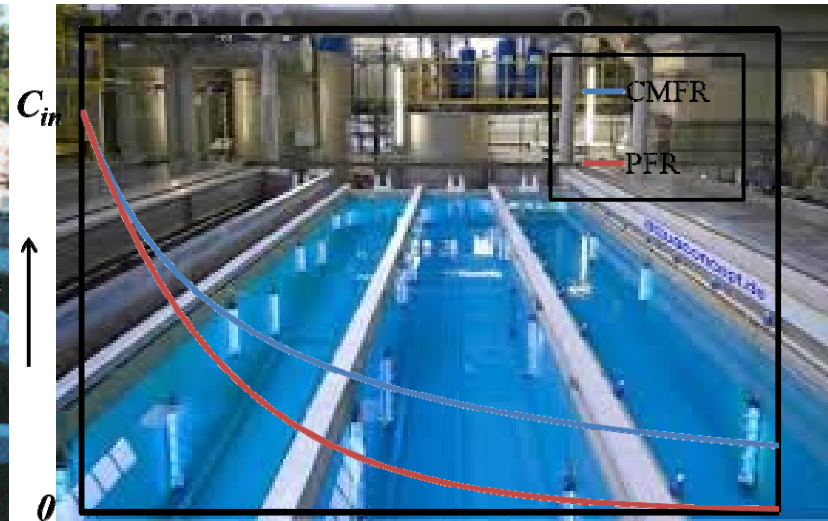

UV disinfection

Types of disinfectants

| Disinfectant | Advantage | Disadvantage |
|-----------------------------|---|---|
| Chlorine (Cl ₂) | <ul style="list-style-type: none"> • Effective for most microorganisms • leaves residual | <ul style="list-style-type: none"> • Forms disinfection byproducts • Not effective to some protozoa • Taste and odor problem |
| Chloramine | <ul style="list-style-type: none"> • More stable residual than chlorine • Less disinfection byproduct than chlorine | <ul style="list-style-type: none"> • Less effective than chlorine |
| Ozone | <ul style="list-style-type: none"> • Very powerful • Effective for most microorganisms, including protozoa | <ul style="list-style-type: none"> • Must be produced on-site • Forms disinfection byproducts • No residual |
| UV | <ul style="list-style-type: none"> • Effective for bacteria & protozoa • No disinfection byproducts | <ul style="list-style-type: none"> • Less effective for some viruses • No residual • Effectiveness affected by turbidity |

Disinfection byproducts

- Disinfectants may react with Br^- or naturally occurring organic matter to make disinfection byproducts (DBPs)
- Some DBPs are known or possible human carcinogens
- Major DBPs
 - Chlorine disinfection: trihalomethanes (THMs), haloacetic acids (HAAs)
 - Ozone disinfection: bromate (BrO_3^-)
- Balance needed for disinfectant dose!
 - Disinfectant dose \uparrow , then pathogen kill \uparrow , but disinfection byproduct \uparrow

Disinfection byproducts



Does swimming do **good** or **bad** for your health??

Chlorine disinfection chemistry


- Chlorine may be added to water as Cl_2 , NaOCl , or Ca(OCl)_2
- Large plants mostly use Cl_2
- Cl_2 rapidly reacts with water to form HOCl :
$$\text{Cl}_2(g) + \text{H}_2\text{O} \rightleftharpoons \text{HOCl} + \text{H}^+ + \text{Cl}^-$$
- HOCl is a weak acid that dissociates to form OCl^- with a pK_a of 7.54 at 25°C:
$$\text{HOCl} \rightleftharpoons \text{H}^+ + \text{OCl}^-$$
- Both HOCl and OCl^- can kill pathogens, but HOCl is much stronger

Chlorine disinfection chemistry

Q: So, for chlorine disinfection, would you prefer high pH ($\text{pH} > 7.54$) or low pH ($\text{pH} < 7.54$)?

Membrane processes

- Getting more and more popular
- Opening size: microfiltration > ultrafiltration > nanofiltration > reverse osmosis

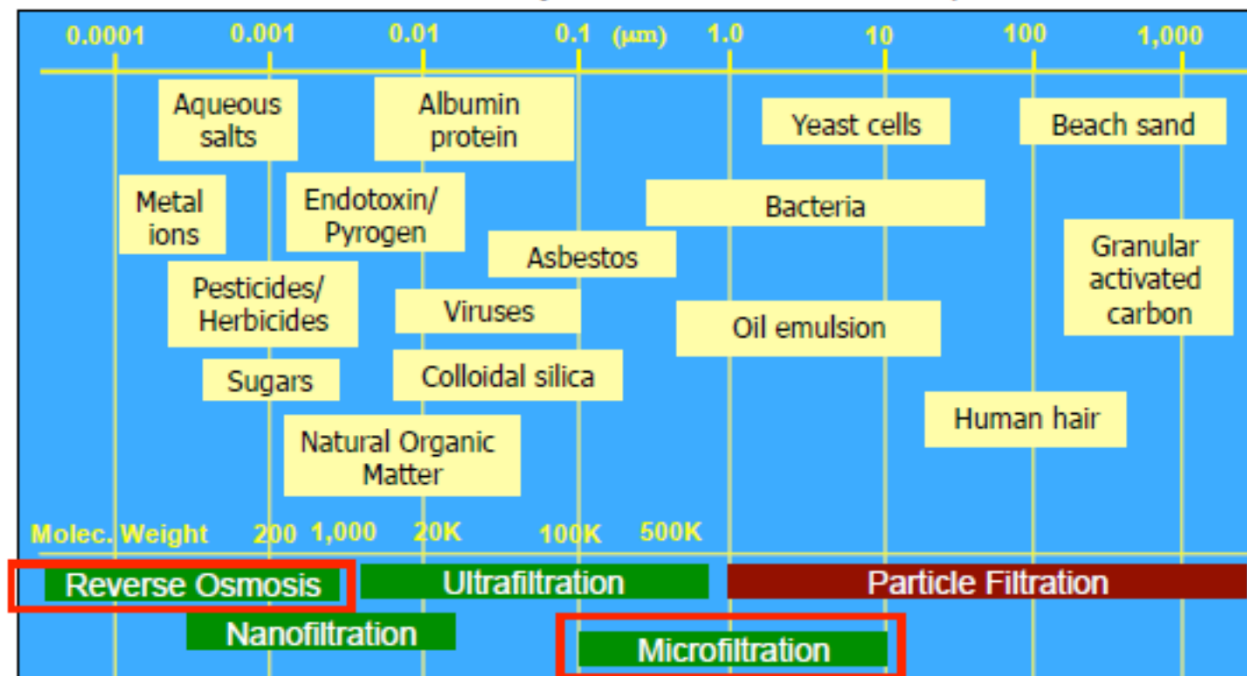

Sludge treatment & disposal

- Large amount of sludge (=mass of settled solids) is produced during the water treatment because of the addition of coagulants or lime
- Major goal of sludge treatment: removing as much water as possible
- When appropriate sludge treatment is accomplished, the sludge is disposed in the landfill



Sludge in the sedimentation basin
<http://www.norfolk.gov>

Reading assignment

Textbook Ch 10 p. 481-495