


# **Wastewater treatment overview**

## **Physical unit processes I**


# Overview of wastewater treatment

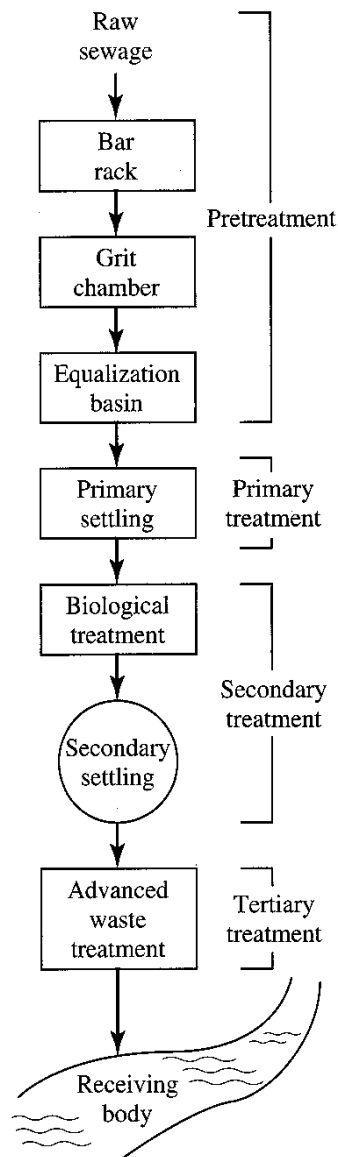


- **Preliminary:** Removal of wastewater constituents such as rags, sticks, floatables, grit, and grease that may cause maintenance or operational problems with the subsequent processes
- **Primary:** Removal of a portion of the suspended solids and organic matter from the wastewater by gravity
- **Secondary:** Removal of biodegradable organic matter and suspended solids by biological treatment. The conventional secondary treatment process may be modified to enhance nutrient removal (biological nutrient removal, BNR)
- **Tertiary** (≈advanced): Polishing secondary effluent by i) enhanced removal of suspended solids, ii) nutrient removal, iii) removal of dissolved species, iv) removal of refractory organics, etc. Disinfection is also often classified as tertiary treatment.

# Typical flow diagrams


(a) Conventional secondary treatment

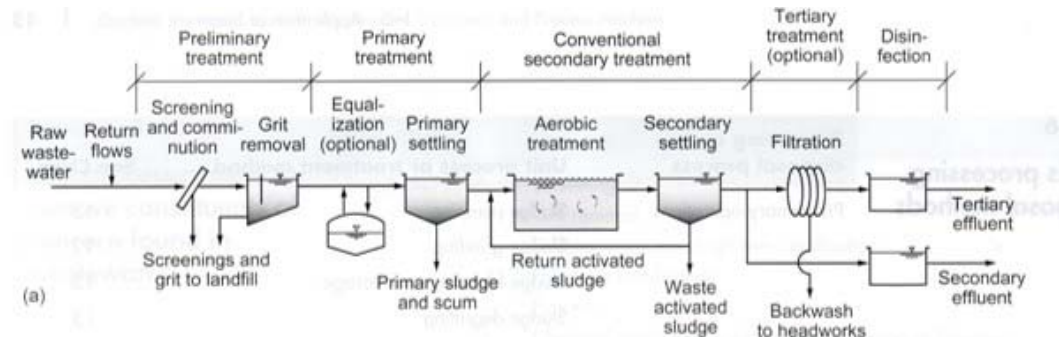


(b) Applying biological nutrient removal

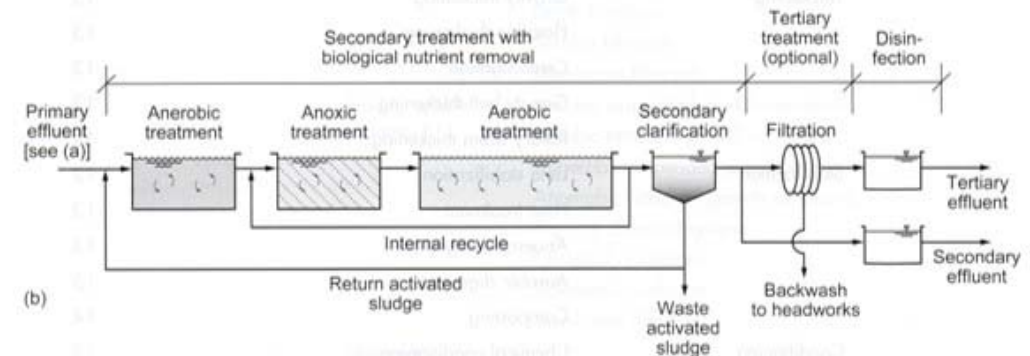

(c) Advanced treatment following secondary treatment (e.g., for water reuse)

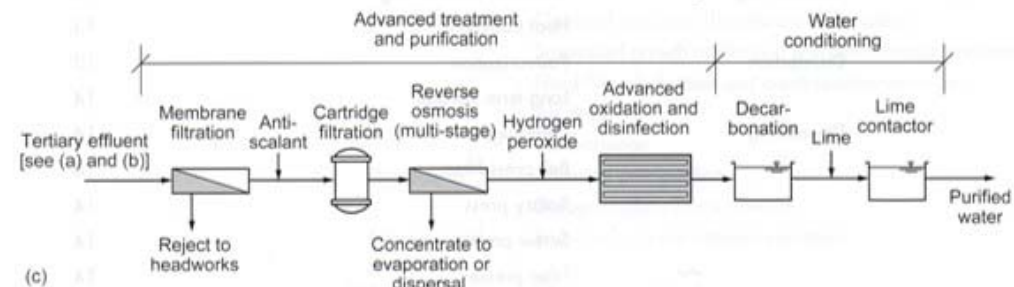


(d) Anaerobic treatment of primary and secondary sludge

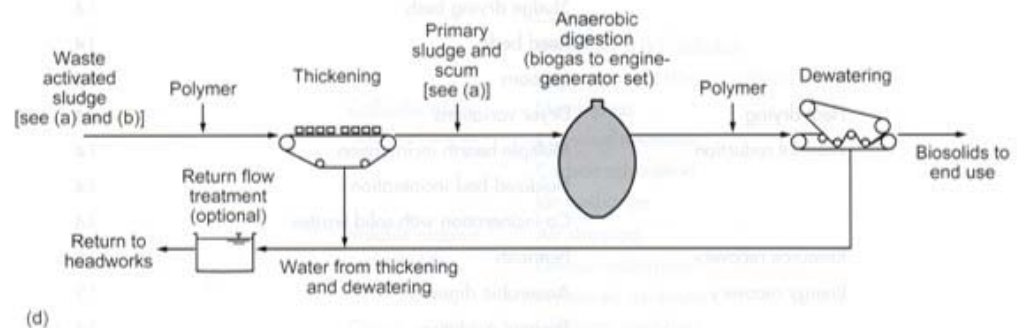


## 탄천물재생센터


2012년1월 이후

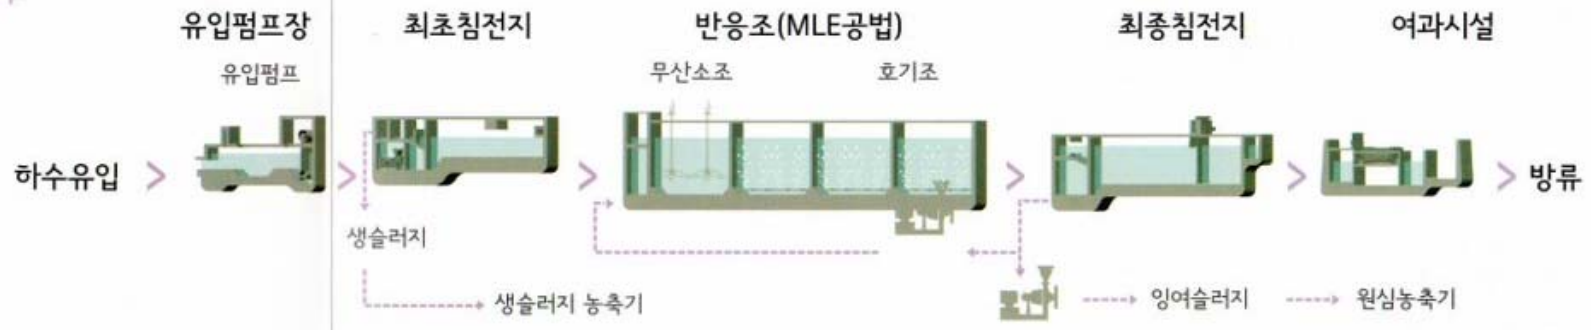

## 중랑물재생센터

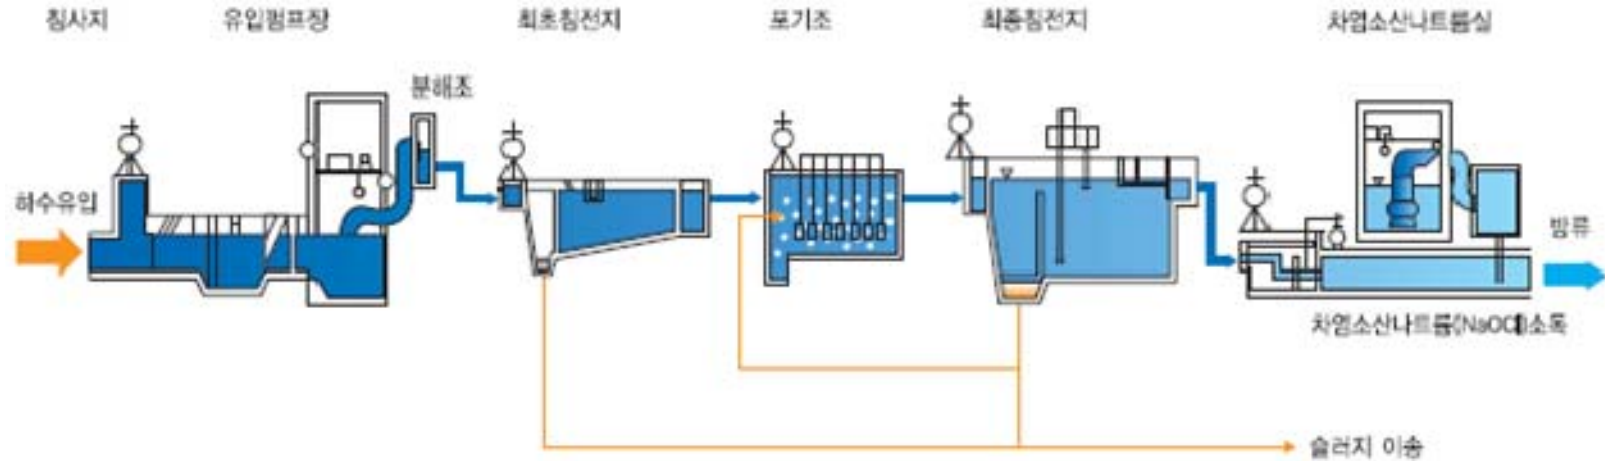


## 서남물재생센터

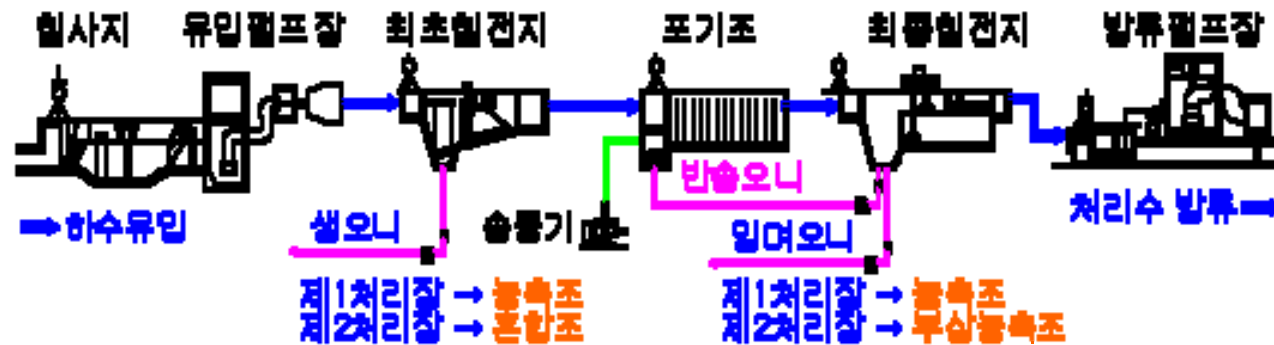

# 난지물재생센터 공정별 처리계통도

Water recycling process diagram of the Nanji Sewage Treatment Center

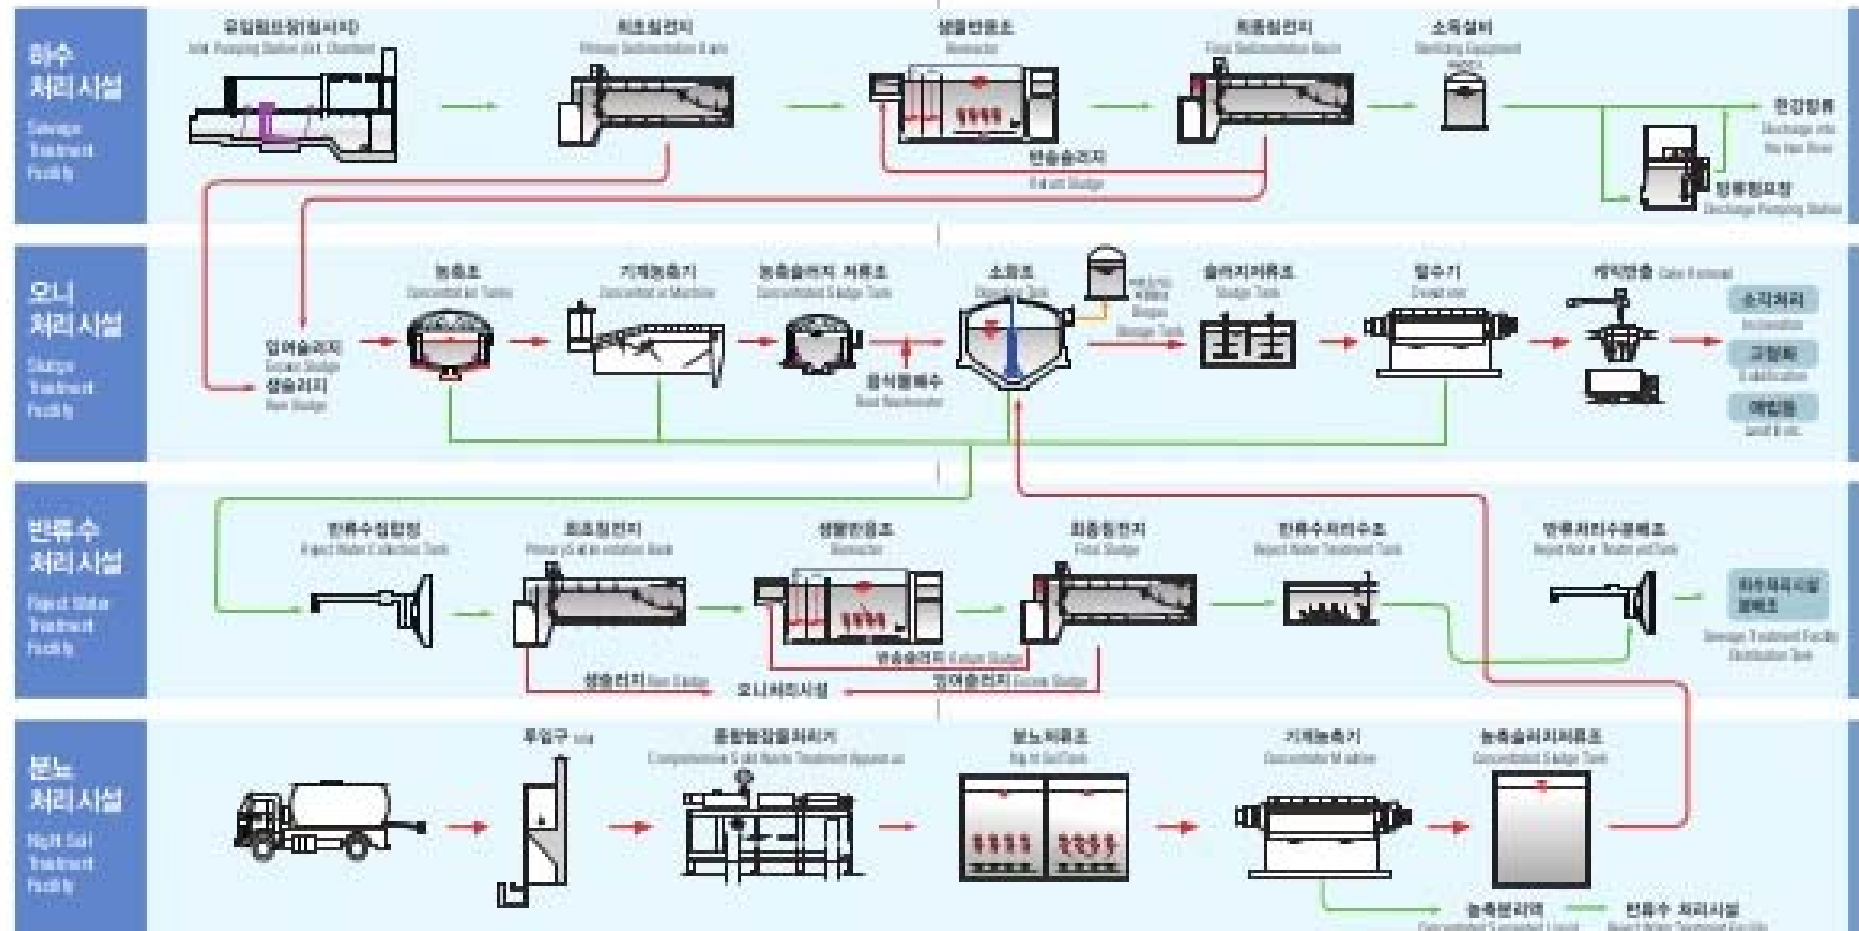

# Overview of wastewater treatment

---

- Wastewater treatment system is a combination of different unit processes
  - Unit processes for **wastewater** and **residual** treatment
- Each unit process has different functions, different target constituents, and different mechanisms
  - Physical, chemical, and biological unit processes

# Unit processes - wastewater

---

## [Unit processes to remove constituents of concern from wastewater]

Target constituent	Unit process
Suspended solids	Screening; Grit removal; Sedimentation; High-rate clarification; Flotation; Chemical precipitation with settling, flotation, or filtration; Depth filtration; Surface filtration; Membrane filtration
Biodegradable organics	Aerobic suspended growth processes; Aerobic attached growth processes; Anaerobic suspended growth processes; Anaerobic attached growth processes; Physical-chemical systems; Chemical oxidation; Advanced oxidation; Membrane filtration
Nitrogen	Chemical oxidation (breakpoint chlorination); Suspended-growth nitrification and denitrification processes; Fixed film nitrification and denitrification processes; Air stripping; ion exchange
Phosphorus	Chemical precipitation; Biological P removal
Nitrogen and phosphorus	Biological nutrient removal processes

# Unit processes - wastewater

---

## [Unit processes to remove constituents of concern from wastewater (cont'd)]

Target constituent	Unit process
Pathogens	Chemical disinfection (chlorine, chlorine dioxide, ozone, etc.); UV radiation; Heat treatment (pasteurization)
Colloidal and dissolved solids	Membrane filtration; Chemical treatment; Carbon adsorption; Ion exchange
Volatile organic compounds	Air stripping; Carbon adsorption; Advanced oxidation
Odors	Chemical scrubbers; Carbon adsorption; Bio-trickling filters; Compost filters



# Unit processes - residuals

---

## [Residuals processing and disposal methods]

Processing or disposal process	Unit process or treatment method
Preliminary operations	Sludge pumping; Sludge grinding; Sludge blending and storage; Sludge degritting
Thickening	Gravity thickening; Flotation thickening; Centrifugation; Gravity belt thickening; Rotary drum thickening
Stabilization	Lime stabilization; Heat treatment; Anaerobic digestion; Aerobic digestion; Composting
Conditioning	Chemical conditioning; Heat treatment
Disinfection	Pasteurization; Long term storage

# Unit processes - residuals

---

## [Residuals processing and disposal methods (cont'd)]

Processing or disposal process	Unit process or treatment method
Dewatering	Centrifuge; Belt press filter; Rotary press; Screw press; Filter press; Electro-dewatering; Sludge drying beds; Reed beds; Lagoons
Heat drying	Dryer variations
Thermal reduction	Multiple hearth incineration; Fluidized bed incineration; Co-incineration with solid wastes
Resource recovery	Nutrient recovery processes
Energy recovery	Anaerobic digestion; Thermal oxidation; Production of oil and liquid fuels
Ultimate disposal	Land application; Landfill; Lagooning

# Physical unit processes

---

- Physical unit processes used in wastewater treatment
  - Screening
  - Coarse solids reduction
  - Flow equalization
  - Mixing and flocculation
  - Grit removal
  - Sedimentation (primary/secondary)
  - Flotation
  - Aeration
  - Filtration
  - VOC removal
  - Air stripping

# Screening

---

- A device with openings, generally of uniform size, used to retain solids found in the wastewater treatment plant influent or in the combined sewer overflows
- Goal: to remove coarse materials that could i) damage subsequent process equipment, ii) reduce overall treatment process reliability and effectiveness, or iii) contaminate waterway
- Classification (by opening size)
  - Coarse screens: >6 mm
  - Fine screens: 0.5-6 mm
  - Microscreens: <0.5 mm
- Major issue: **headloss** (more significant for smaller opening size)

# Coarse screens (bar racks)

---

- Used to protect pumps, valves, pipelines, and other apparatus from damage or clogging by rags and large objects
- Manually-cleaned (old and/or small plants) vs. mechanically cleaned screens



***Top: Manually-cleaned bar screen***

*<http://techalive.mtu.edu>*

***Bottom: Mechanically-cleaned bar screen***

*<http://www.degremont-technologies.com>*

# Fine & micro screens

---


- **Fine screens - uses**
  - i) additional preliminary treatment following coarse bar screens
  - ii) primary treatment as a substitute for primary clarifiers
  - iii) CSO treatment
  - iv) Non-point source pollution (surface runoff) control
- **Microscreens**
  - Major uses: to remove SS from secondary effluent (as a means of advanced treatment)
  - Not frequently used

# Fine screens


---




(a)

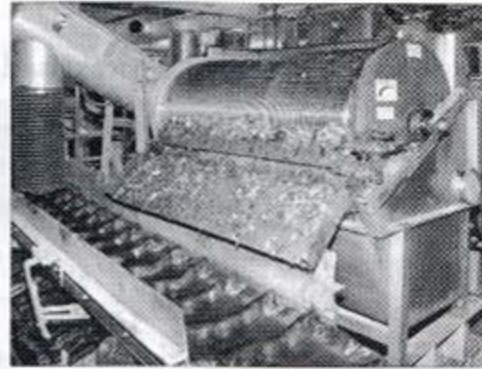

(b)



(c)

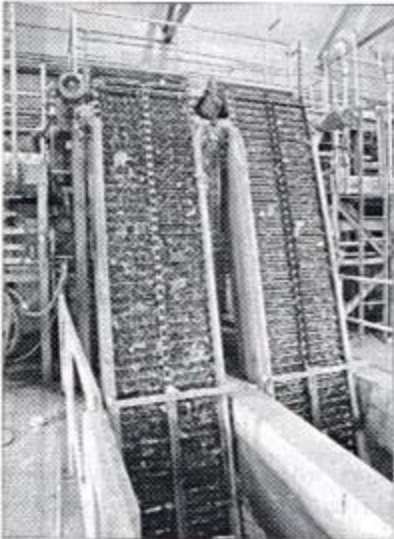

(d)




(e)

Typical fine screens for preliminary & primary treatment: (a) Static wedge wire; (b) wedge-wire drum screen; (c) section through wedge wire screen; (d) traveling band screen; and (e) step screen





# Fine screens

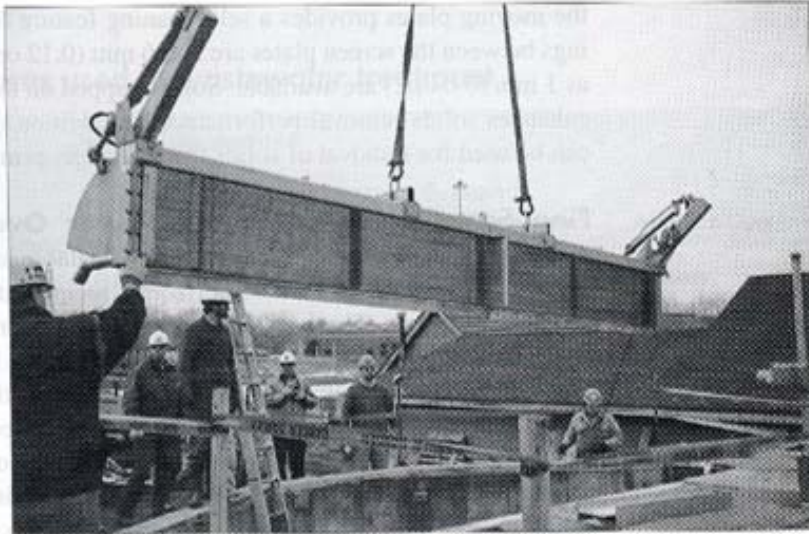

Horizontal bar screen  
with reciprocating cutting  
head which moves back  
and forth along bar screen

Water level  
during peak  
stormflow

Bar screen rotates  
to increase surface area  
exposed for screening

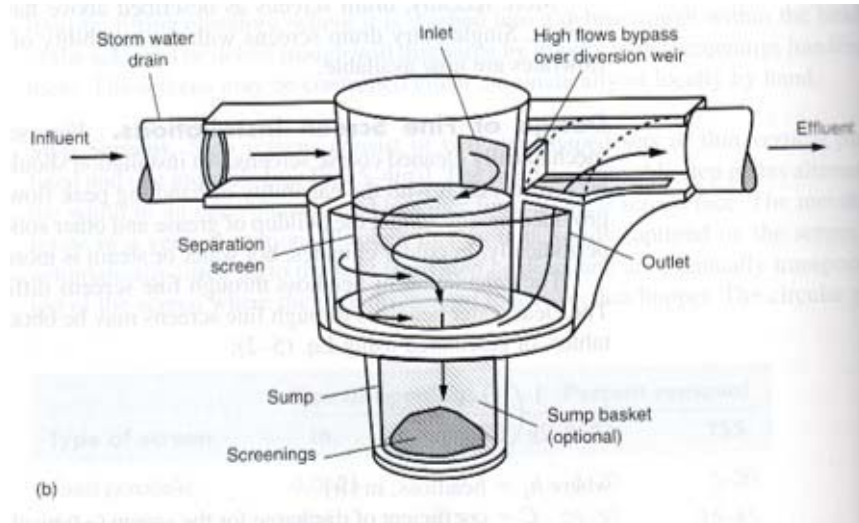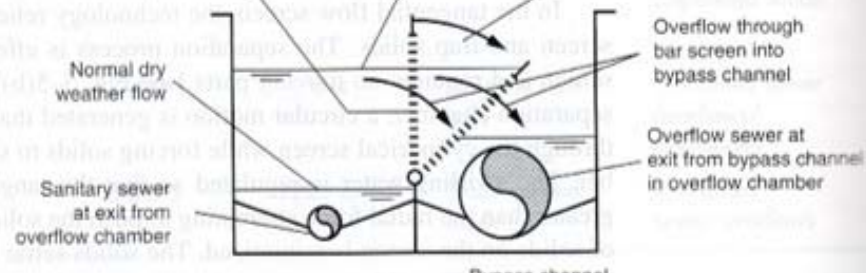

Devices used for the screening of CSOs:  
(a) view of horizontal screen during installation and its operating mechanism;  
(b) tangential flow device with separation screen



# Screening

---

- **Materials retained on screens**
- **Characteristics**
  - Screenings retained on coarse screens
    - Mainly inert materials (rocks, branches, pieces of lumber, leaves, paper, tree roots, plastics, rags, ...)
    - Some accumulation of oil and grease and organic matter may occur
  - Screenings retained on fine screens
    - Small rags, paper, plastic materials, razor blades, grit, undecomposed food waste, feces, ...
    - Slightly lower specific weight, higher moisture content, and high organic matter content than screenings on coarse screens
    - Biodegradable organic matter putrefies to generate odor, so additional care is required

# Screening

---

- Screening handling, processing, and disposal
  - Screening handling and processing
    - Major goal: volume reduction
    - Dewatering and compaction
  - Screening disposal
    - 1) Removal by moving to disposal areas (landfill) – most common
    - 2) Burial on the plant site (only for small plants)
    - 3) Incineration
    - 4) Discharge to grinders or macerators and return to the wastewater

# Mixing

---

- Application of mixing in wastewater treatment
  - Continuous rapid mixing
    - Blending of chemicals with wastewater
    - Blending of miscible liquids
    - Addition of chemicals to sludge and biosolids
  - (Slower) Continuous mixing
    - Keeping the contents of a reactor or storage tanks in suspension (e.g., for biological treatment)
    - Flocculation (after adding coagulants - more common in drinking water treatment!)

# Mixing

---

- Velocity gradients and power requirement
  - Mixing can be viewed as a development of velocity gradients among fluid
  - “G value”: average velocity gradient, a measure of mixing intensity

Camp and Stein (1943)

$$G = \sqrt{\frac{P}{\mu V}}$$

*G = average velocity gradient (1/s)*

*P = power requirement (W)*

*$\mu$  = dynamic viscosity (N-s/m<sup>2</sup>)*

*V = reactor volume (m<sup>3</sup>)*



The effectiveness of mixing is a function of power input per volume



Greater power requirement to achieve greater G with the same reactor volume;

Greater power requirement to achieve the same G with the larger reactor volume

# Mixing

---

- rapid mixing:  $G \uparrow$  with small  $\tau$
- gentle mixing (flocculation):  $G \downarrow$  with large  $\tau$

Process	Range of values	
	Retention time	G value, $s^{-1}$
Mixing		
Typical rapid mixing operations in wastewater treatment	5-30 s	500-1500
Rapid mixing for effective initial contact and dispersion of chemicals	<1 s	1500-6000
Rapid mixing of chemicals in contact filtrations processes	<1 s	2500-7500
Flocculation		
Typical flocculation processes used in wastewater treatment	30-60 min	50-100
Flocculation in direct filtration processes	2-10 min	25-150
Flocculation in contact filtration processes	2-5 min	25-200

# Mixing

---

**Q:** Determine the theoretical power requirement to achieve a G value of 100/s in a tank with a volume of 2800 m<sup>3</sup>. Assume that the water temperature is 15°C. What is the corresponding value when the water temperature is 5°C?


Dynamic viscosity values:

15°C:  $1.139 \times 10^{-3}$  N-s/m<sup>2</sup>


5°C:  $1.518 \times 10^{-3}$  N-s/m<sup>2</sup>

# Types of mixers


Typical mixers  
used for rapid  
mixing of  
chemicals

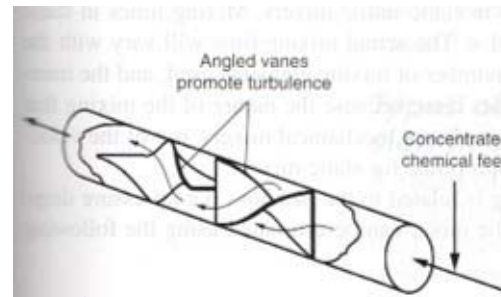


Inline static mixer  
with internal vanes

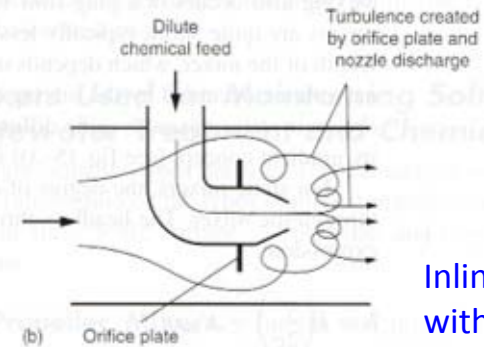

Inline static mixer  
with orifice


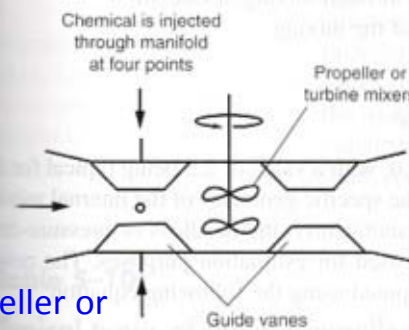


Inline propeller or  
turbine mixer

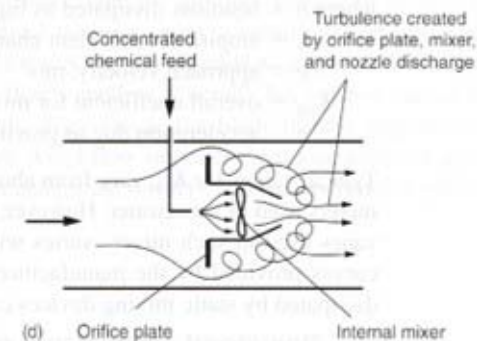

Inline mixer with  
orifice and internal  
propeller mixer

High-speed  
induction mixer

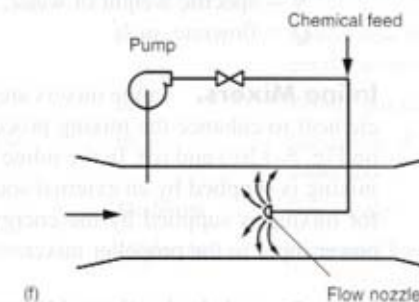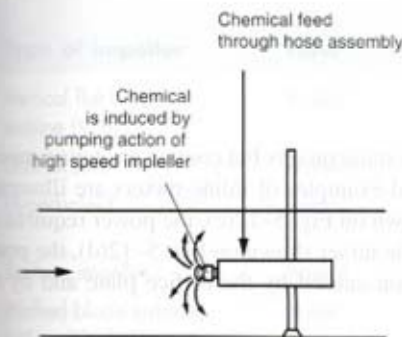


Pressurized water  
jet mixer

# Types of mixers

---

Mixers for maintaining solids in suspension and chemical blending in reactors: turbine and propeller mixers most common

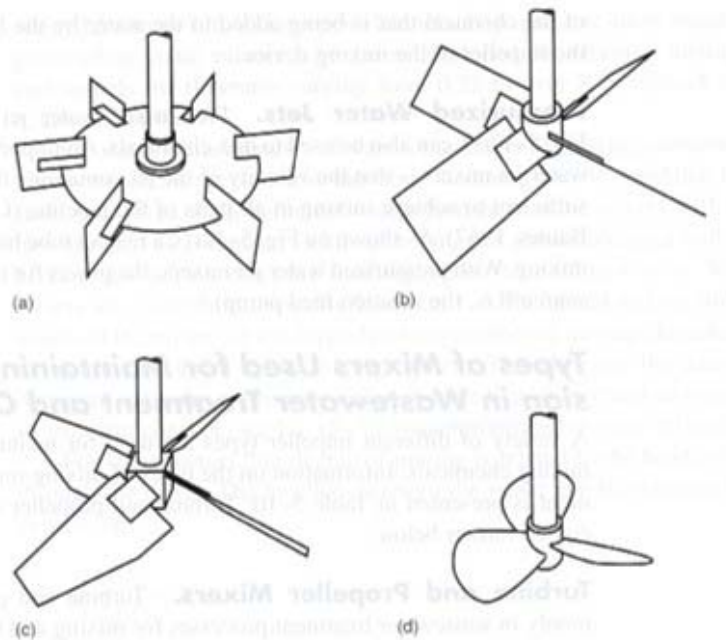





# Types of mixers

---

- Type of mixers used for biological treatment
  - Pneumatic mixing
    - mixing is provided by injecting gas into the bottom of tanks
    - both mixing effect & oxygen supply
    - used for aeration tank of an activated sludge process

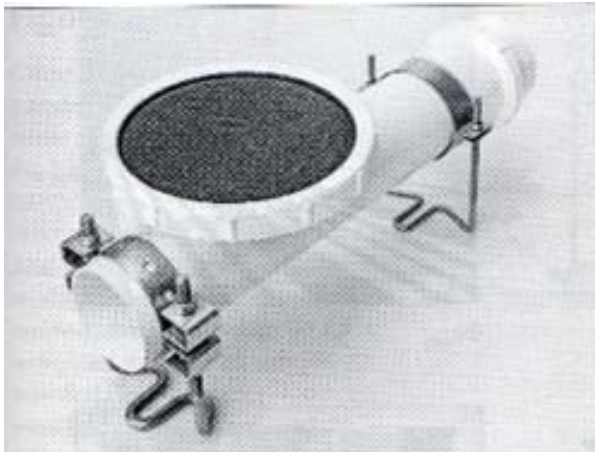

Ceramic disk diffuser

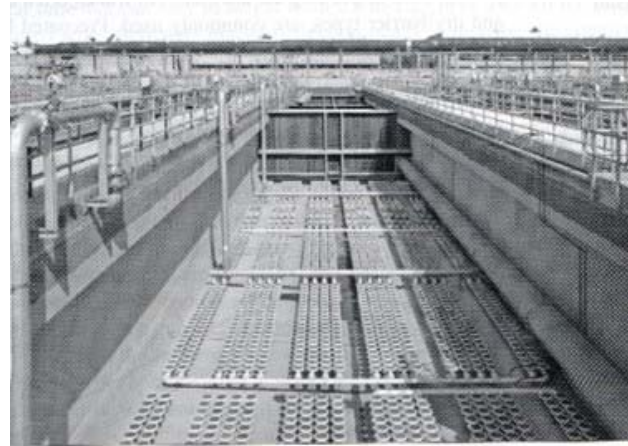


Aeration tank equipped with ceramic disk aeration devices


# Types of mixers

---

- Type of mixers used for biological treatment (cont'd)
  - Mechanical aerators and mixers
    - for anoxic/anaerobic reactors and oxidation ditches

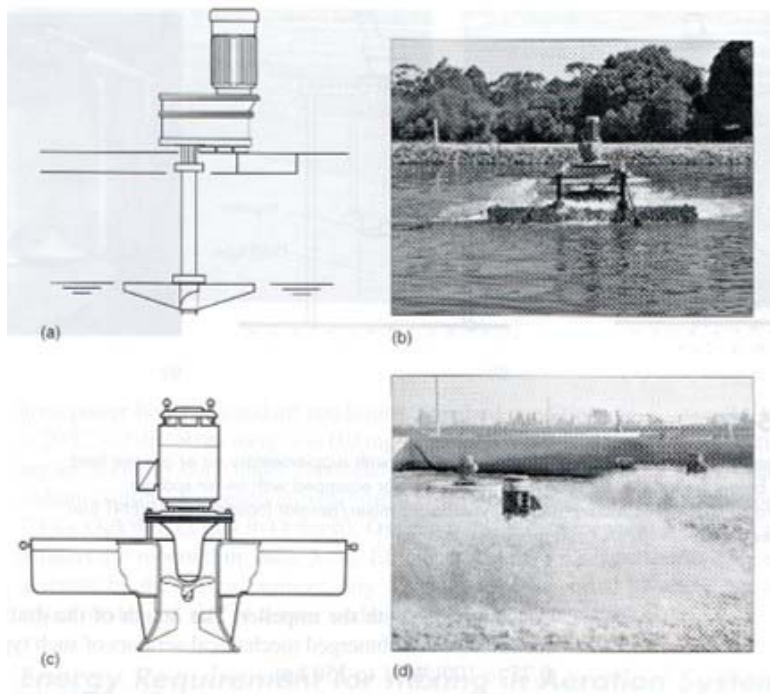

Surface mechanical aerators: (a), (b) – low-speed; (c), (d) – high-speed

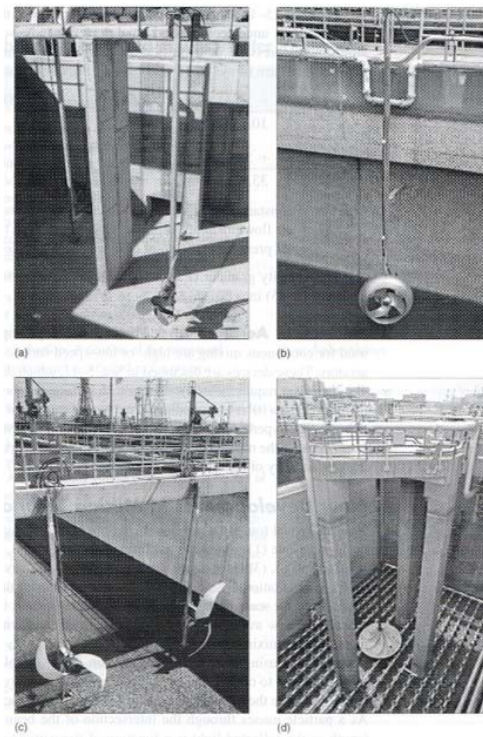

Mixers for anoxic reactors: (a), (b) - propeller; (c) - airfoil mixer; (d) - hyperbolic mixer

# Types of settling

---

- Class I settling – **Discrete particle settling**
  - At low solids concentration
  - Particles settle as individual entities, no significant interaction with neighboring particles
  - ex) removal of grit and sand particles
- Class II settling – **Flocculent settling**
  - Particles grow as they settle
  - Settling velocity increases as particles grow in size
  - ex) primary settling & upper part of secondary clarifier



<https://dir.indiamart.com/vadodara/wastewater-treatment-chemical.html>

# Types of settling


---

- Class III settling – **zone (or hindered) settling**
  - At higher solids concentration than Class I or II – interparticle forces are sufficient to hinder the settling of neighboring particles
  - Mass of particles settles as a unit; a solid-liquid interface develops at the top
  - ex) major part of secondary clarifier
- Class IV settling – **compression settling**
  - When solids concentration is sufficiently high – a structure is formed
  - Settling occurs only by compression of the structure by the weight of particles
  - Observed phenomenon is more like squeezing of water out of the structure
  - ex) bottom of deep secondary clarifier, sludge-thickening facilities

# Particle settling theory – discrete particles

---

- Force applied to a settling particle  
(Assumption: spherical particle)

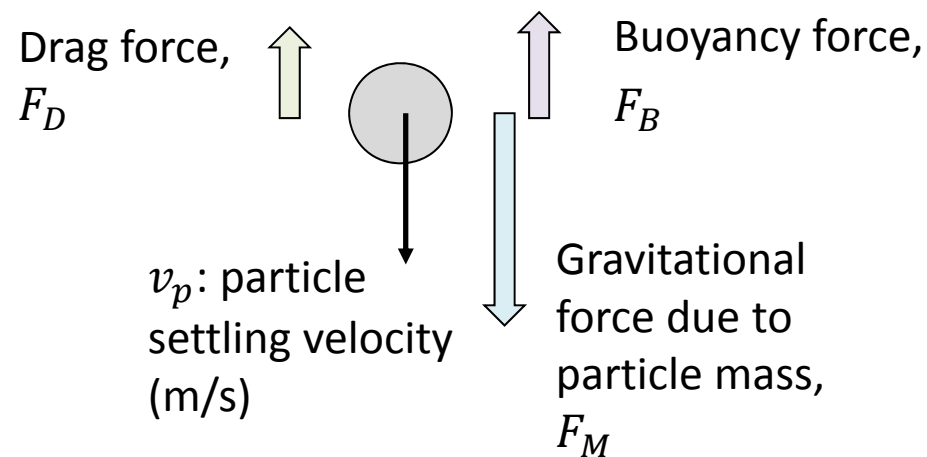

$$F_B = \rho_w g V_p$$

$\rho_w$  = water density ( $\text{kg/m}^3$ )

$g$  = gravity acceleration ( $9.81 \text{ m/s}^2$ )

$V_p$  = particle volume ( $\text{m}^3$ )

$$F_M = \rho_p g V_p$$

$\rho_p$  = particle density ( $\text{kg/m}^3$ )

$$F_D = \frac{C_D A_p \rho_w v_p^2}{2}$$

$C_d$  = drag coefficient (unitless)


$A_p$  = cross-sectional area of particles in the direction of flow ( $\text{m}^2$ )

# Particle settling theory – discrete particles

---

- The terminal velocity of particle is achieved when the three forces are balanced:

$$F_M = F_B + F_D$$


$$v_{p(t)} = \sqrt{\frac{4g}{3C_D} \left( \frac{\rho_p - \rho_w}{\rho_w} \right) d_p}$$

*$v_{p(t)}$  = particle terminal velocity (m/s)*

*$d_p$  = particle diameter (m)*

# Particle settling theory – discrete particles

---

- Drag coefficient,  $C_D$ 
  - Divide the flow regime into three regions – laminar, transitional and turbulent – based on Reynolds number
  - **Reynolds number,  $N_R$** 
    - A dimensionless number to describe the relative amount of impelling force to viscous force
    - High  $N_R \rightarrow$  more turbulence

$$N_R = \frac{v_p d_p \rho_w}{\mu} = \frac{v_p d_p}{\nu}$$


$\mu$  = dynamic viscosity of water [N-s/m<sup>2</sup>]

$\nu$  = kinematic viscosity of water [m<sup>2</sup>/s]

# Particle settling theory – discrete particles

---

- Correlation between  $N_R$  and  $C_D$

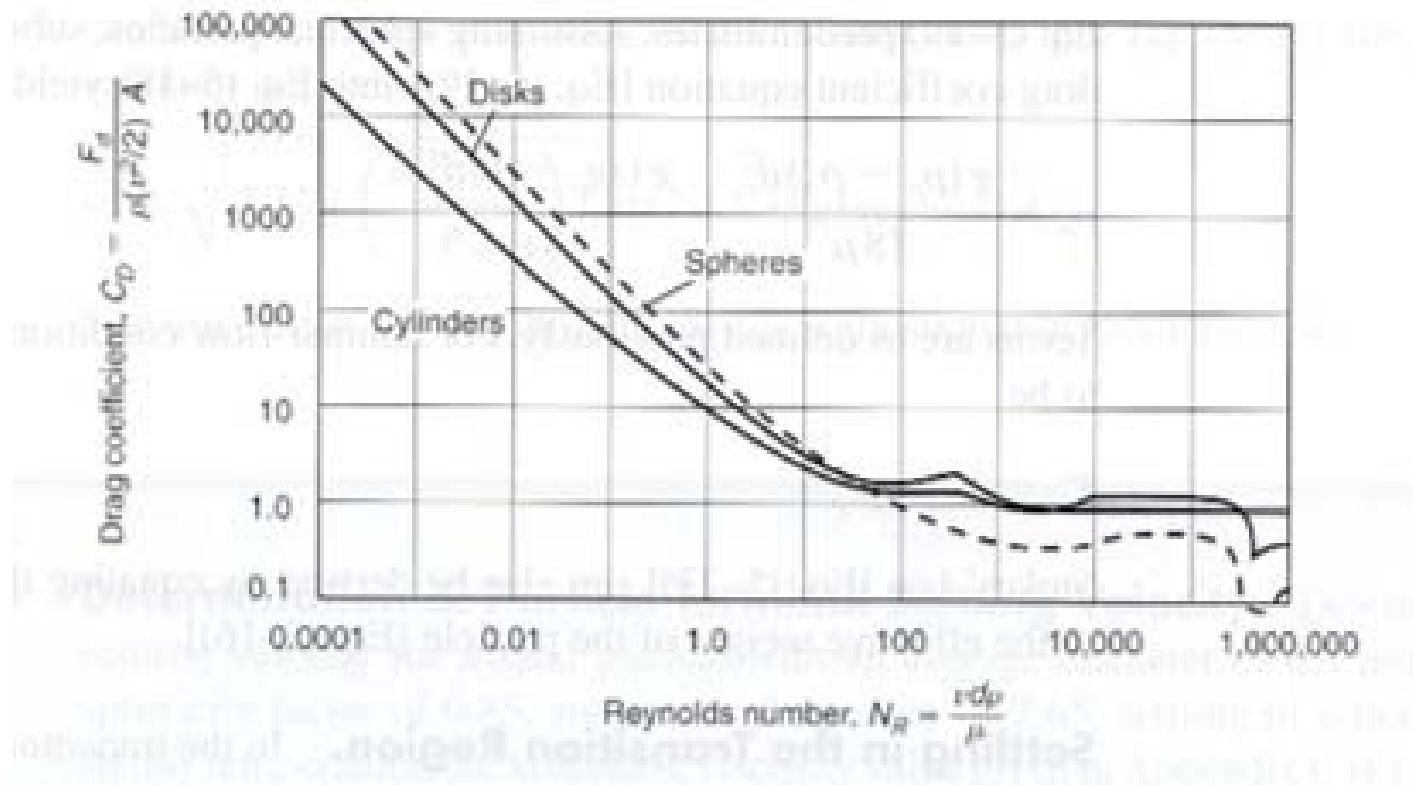



# Particle settling theory – discrete particles

---

1) Laminar region:  $N_R < 1$

$$C_D = \frac{24}{N_R} \Rightarrow \boxed{v_{p(t)} = \frac{g(\rho_p - \rho_w)d_p^2}{18\mu}}$$

*“Stokes’ Law”*

2) Transitional region:  $1 < N_R < 2000$

Use following eq. for approximation of  $C_D$ :

$$C_D = \frac{24}{N_R} + \frac{3}{\sqrt{N_R}} + 0.34$$

3) Turbulent region:  $N_R > 2000$

Assume  $C_D \approx 0.4$

# Particle settling theory – discrete particles

---

- For non-spherical particles
  - Use “sphericity” to account for shape variation

$$\Psi = \frac{(A/V)_{sphere}}{(A/V)_{particle}} \quad \Psi = \text{sphericity} \quad \begin{array}{l} \Psi \approx 0.8 \text{ for sharp, angular sand} \\ \Psi \approx 0.94 \text{ for worn sand} \end{array}$$

- Apply “effective spherical diameter” in the equations

$$d_p' = \Psi \cdot d_p \quad \begin{array}{l} d_p' = \text{effective spherical diameter} \\ d_p = \text{characteristic length} \end{array}$$

[Typical sphericity for different shapes]

Particle	Sphericity	Characteristic length
Sphere	1.00	Diameter
Cube	0.806	Height
Cylinder (h=10r)	0.691	Length
Disc (h=r/10)	0.323	Diameter

# Particle settling velocity

---

**Q:** Determine the terminal settling velocity of a spherical bacterial floc having a density of  $1.050 \times 10^3 \text{ kg/m}^3$  when the floc size is i)  $10^{-4} \text{ m}$  and ii)  $10^{-3} \text{ m}$ , respectively. Assume the flocs are spherical. Assume the temperature is  $20^\circ\text{C}$ . ( $\rho_w = 0.998 \times 10^3 \text{ kg/m}^3$  and  $\mu = 1.002 \times 10^{-3} \text{ N-s/m}^2$ )