


Biological wastewater treatment I

Today's lecture

- Conventional activated sludge process
 - : *Most common approach for BOD removal*
 - Design parameters
 - Settling problems
- Biological nutrient removal
 - : *Conventional strategies to improve N removal efficiency in the secondary treatment*
 - Nitrification
 - Denitrification


Analyzing activated sludge process

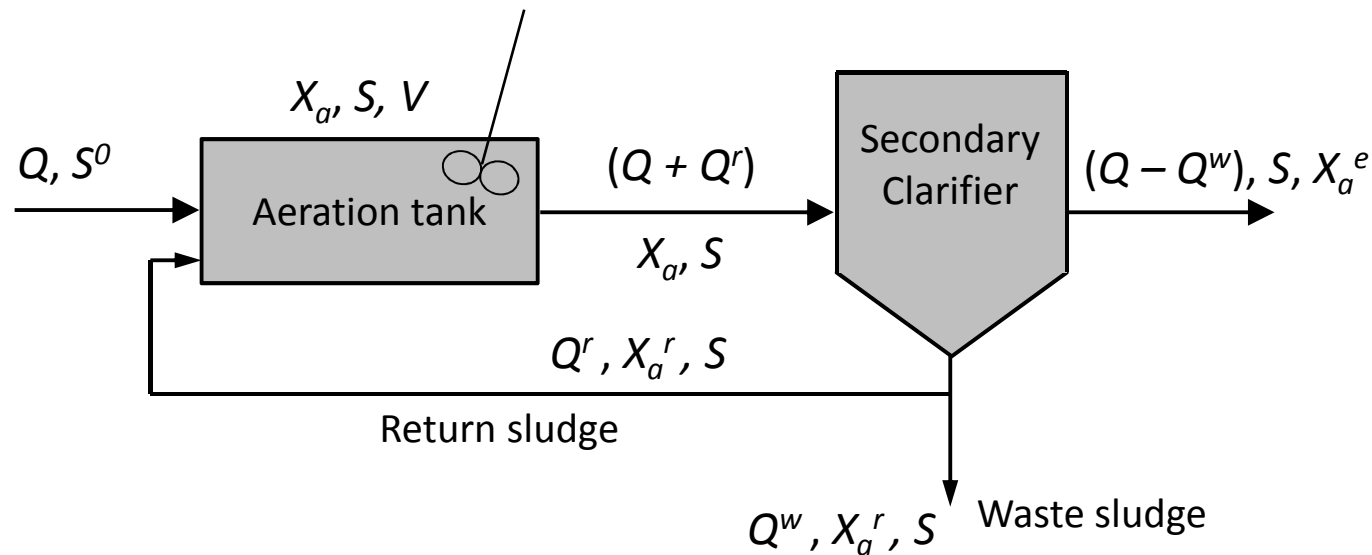

Remember:

$$S = K \frac{1 + b\theta_x}{\theta_x(Y\hat{q} - b) - 1}$$

$$X_a = \frac{\theta_x}{\theta} \frac{Y(S^0 - S)}{1 + b\theta_x}$$



SRT a key parameter

Aeration tank & clarifier



Other important design parameters

- **Food-to-microorganism ratio (F/M)**

with respect to TSS:

$$F/M = \frac{Q^0 S^0}{VX}$$

with respect to VSS:

$$F/M_v = \frac{Q^0 S^0}{VX_v}$$

X = total suspended solids (TSS) in aeration tank (mg/L)

X_v = volatile suspended solids (VSS) in aeration tank (mg/L)

- **Volumetric organic loading rate (OLR):** the amount of BOD or COD applied to the aeration tank volume per day

$$\text{Volumetric OLR} = \frac{Q^0 S^0}{V}$$

Sludge settling problems

- Major cause of the exceedance of the effluent standard for SS & BOD/COD
- **Bulking sludge**
 - Sludge blanket not stable; large quantities of SS carried along with the clarifier effluent
 - Filamentous bulking: growth of filamentous organisms
 - Viscous bulking: production of excessive amount of extracellular biopolymers
- **Air bubbles captured in flocs**
 - Nocardioform foam: excessive growth of “Nocardioform” bacteria, which have hydrophobic cell surfaces and thus collects air bubbles
 - Rising sludge: due to internal gas production in flocs (most often N₂ production by denitrification)




Biological oxidation of nitrogen

- Necessity for $\text{NH}_4\text{-N}$ & $\text{NO}_2\text{-N}$ oxidation
 - The effect of ammonia on receiving water with respect to DO concentrations and fish toxicity
 - The need to provide nitrogen removal to control eutrophication
 - The need to provide nitrogen control for water-reuse applications
- **Nitrification**
 - Two-step biological process: $\text{NH}_4\text{-N} \rightarrow \text{NO}_2\text{-N}$ & $\text{NO}_2\text{-N} \rightarrow \text{NO}_3\text{-N}$
 - The first step [$\text{NH}_4\text{-N} \rightarrow \text{NO}_2\text{-N}$] is termed as “nitritation”
 - Different type of microorganisms are involved for each step

Nitrification: Processes & microbiology

- Process
 - Both suspended & attached growth applicable
 - Suspended growth nitrification processes
 - Note nitrifying bacteria are less competent than aerobic heterotrophs → need maintaining low BOD conc. to activate them!
 - So: operate the reactor **at higher SRT** than what's needed for BOD removal
- Microbiology
 - Ammonia-oxidizing bacteria (AOB) & nitrite-oxidizing bacteria (NOB) --- aerobic chemoautotrophs
 - AOBs: *Nitrosomonas* (+*Nitrosospira*)
 - NOBs: *Nitrobacter* (+*Nitrococcus*, *Nitrospina*, *Nitrospira*)

Nitrification stoichiometry




*Note: This is the stoichiometry for **energy reaction** (NOT accounting for biomass growth)*

- Oxygen requirement: 2 mole O_2 /1 mole NH_4^+
= 4.57 g O_2 /g NH_4 -N oxidized
- Alkalinity consumption: 2 eq alkalinity/1 mole NH_4^+
= 7.14 g Alk as $CaCO_3$ /g NH_4 -N oxidized
- Nitrification cell yield: 0.10~0.15 for AOB & 0.04~0.07 for NOB
- Considering biomass production, the O_2 requirements and alkalinity consumption is slightly less than the calculated values above (**why??**)

Nitrification stoichiometry

ex) Assuming $Y=0.12$ g VSS/g $\text{NH}_4\text{-N}$ for AOB and $Y=0.04$ g VSS/g $\text{NO}_2\text{-N}$ for NOB, the overall stoichiometry is:

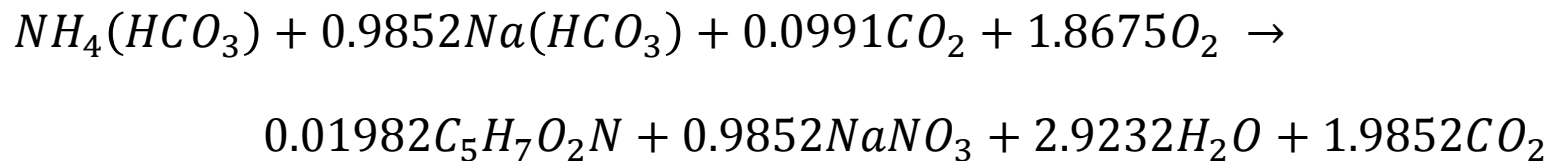

→ 1.8675 mole O_2 /1 mole NH_4^+

1.9852 eq Alk/1 mole NH_4^+

Environmental factors affecting nitrification

- **DO concentration**

- Nitrifying bacteria are more sensitive to DO than heterotrophs
- Nitrite oxidation is inhibited more at low DO than ammonia oxidation
→ elevated $\text{NO}_2\text{-N}$ concentration at low DO

- **pH**

- Optimum at pH of 7.5~8.0
- Ammonia oxidation rate reduces significantly at $\text{pH} < 7.0$
- Possibly due to the reduction of free ammonia (NH_3) concentration
- **Sufficient alkalinity is needed!**
- For wastewater with high NH_4^+ concentrations and low alkalinity, addition of alkalinity may be needed (lime, soda ash, NaHCO_3 , ...)

Environmental factors affecting nitrification

- **Toxicity**
 - AOB is sensitive to a wide range of organic & inorganic compounds
 - Show significantly reduced ammonia oxidation rate in the presence of toxic substances
- **Free ammonia & nitrous acid inhibition**
 - $\text{NH}_3\text{-N}$ & HNO_2
 - High pH: $\text{NH}_3\text{-N}$ \uparrow / low pH: HNO_2 \uparrow

Denitrification


- **Biological reduction of nitrate (NO_3^-) or nitrite (NO_2^-) to nitrogen gas (N_2)**
- **Denitrification required**
 - To complete the biological nitrogen removal process
 - Otherwise, accumulation of $\text{NO}_3\text{-N}$: health threats!
 - “Blue baby syndrome”
 - Korean regulation: $< 10 \text{ mg NO}_3\text{-N/L}$
- **Usually by heterotrophic bacteria**
 - Wide range of heterotrophs – mostly facultative aerobes
 - Some autotrophs are capable of nitrate/nitrite reduction
 - Use Fe^0 , Fe^{2+} , S^{2-} , S^0 , ..., or NH_4^+




#1

Denitrification

- Two modes of nitrate removal in biological processes
 - **Assimilatory nitrate reduction**
 - Reduction of $\text{NO}_3\text{-N}$ to $\text{NH}_4\text{-N}$ for use in cell synthesis when $\text{NH}_4\text{-N}$ is not available
 - Independent of DO concentration
 - **Dissimilatory nitrate reduction:** much more significant!
 - Nitrate/nitrite serves as an electron acceptor
 - When DO is absent or limited
 - Mostly facultative bacteria
 - Nitrate reduction proceeds through a series of intermediate products:




Denitrification processes

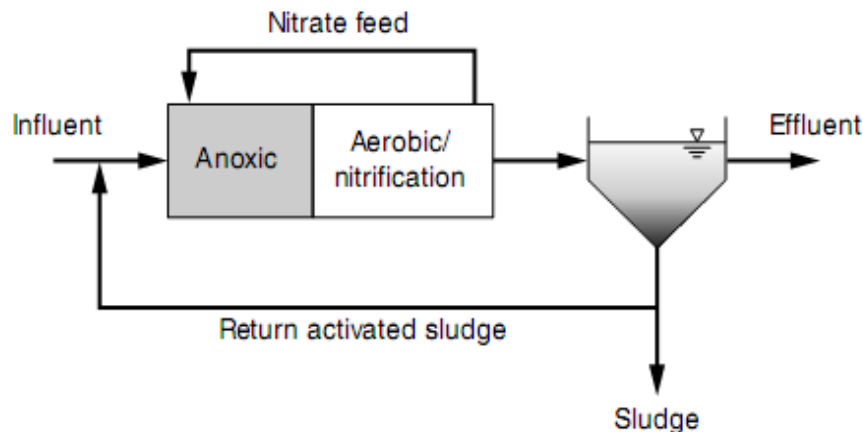

- **Preanoxic denitrification**




- Electron donor provided by influent
- MLE (Modified Ludzak-Ettinger) process: most common for biological nitrogen removal in municipal wastewater treatment

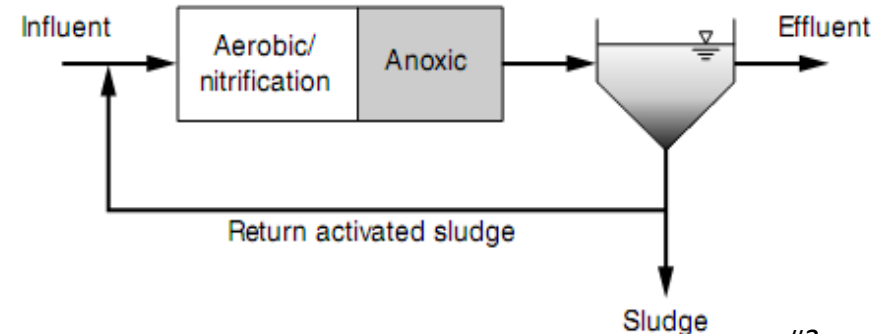

- **Postanoxic denitrification**

- BOD not available in anoxic reactor: denitrification by endogenous decay
- Much slower rate than preanoxic
- Often external carbon source is added (e.g. methanol, acetate)

Denitrification Stoichiometry



— Production of alkalinity

- 3.57 g Alk as $CaCO_3$ produced per g NO_3^- -N (or NO_2^- -N) reduced
- 50% of alkalinity consumed by nitrification can be recovered

Denitrification: Organic substrate requirements

- A sufficient amount of organic substrate (e^- donor) should be available
 - **bsCOD or BOD as an important design parameter**
 - **Sources of e^- donor for denitrification**
 - 1) bsCOD in the influent
 - 2) bsCOD produced during biological hydrolysis
 - 3) bsCOD produced during endogenous decay
 - 4) External source such as methanol or acetate
 - **~4 g BOD required per g $\text{NO}_3\text{-N}$ reduced**
 - actual requirement depending on operating conditions and the type of e^- donor
 - Especially important to determine the BOD requirements when external carbon source is provided

References

#1) <http://www.fesmu.ru/www2/PolTxt/U0008/vitium/sl20/resume20.htm>

#2) Metcalf & Eddy, Aecom (2014) *Wastewater Engineering: Treatment and Resource Recovery*, 5th ed. McGraw-Hill, p. 633.